



**Title: Sound Absorption Test Results**

**Product: Audition 8 Wall or Ceiling Panel with 1" Acoustical Backer**

Application: Ceiling

Testing Standard: ASTM C423-17 (Type E400 Mount)


Test Date: 7/31/2019

*Why this test:* This test evaluates a products efficiency of absorbing sound at multiple frequencies. The test simulates the product’s acoustical performance with a lay-in ceiling installation.

Test Result Summary: NRC - 0.85; SAA - 0.82

<b>NRC</b>	<b>SAA</b>
<b>0.85</b>	<b>0.82</b>

Frequency (Hz)	Absorption Coefficient
100	0.84
125	0.57
160	0.70
200	0.61
250	0.71
315	0.82
400	0.80
500	0.86
630	0.92
800	0.91
1000	0.93
1250	0.88
1600	0.82
2000	0.80
2500	0.81
3150	0.81
4000	0.86
5000	0.89

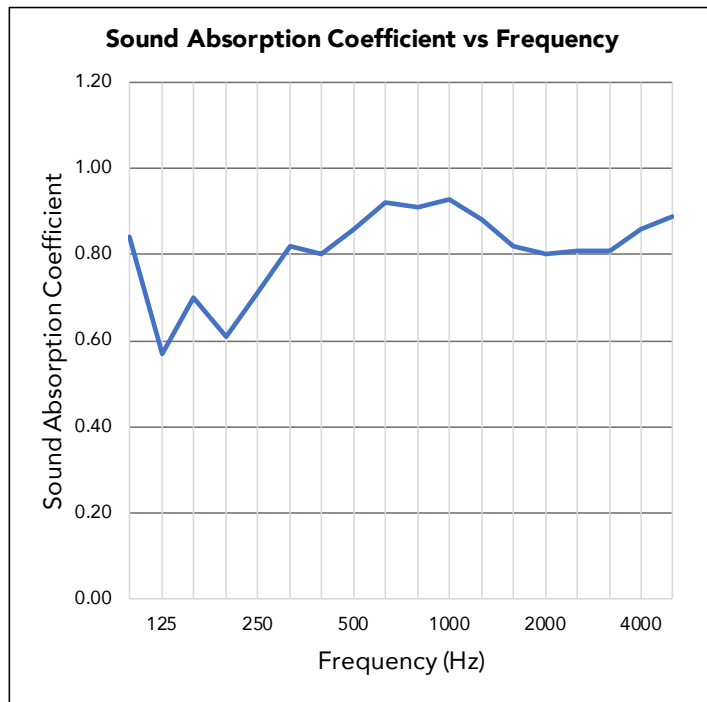

Test ID: OL19-0726

**ASI TEST RESULT DISCLAIMER**

ASI makes every effort to ensure the accuracy and reliability of the information provided. Laboratory testing is conducted by independent testing organizations. ASI does not guarantee that field tests or independent tests will not vary.

©2020 ASI Architectural

# Sound absorption coefficient according to ASTM C423 - 17


Measurement of sound absorption coefficient in a reverberation room

Client: ASI Date of test: 7/31/2019  
 Description: Audition 8 Perforated Wall Panel  
 E400 Mounting  
 Weight: 160.35 lbs. (72.73 kg) Backing: 14.95 lbs. (6.78 kg)

Object: 4 - 4'x4' & 2 - 1'x4' ASI Audition 8 panels   
 With 1" Backer


Empty reverberation room:		Reverberation room with object:	
Relative humidity:	45.0 %	Relative humidity:	45.0 %
Temperature:	21.0 °C	Temperature:	21.0 °C
Barometric pressure:	760.0 mbar	Barometric pressure:	760.0 mbar

Surface area: 6.69 m<sup>2</sup>  
 Room volume: 234.4 m<sup>3</sup>

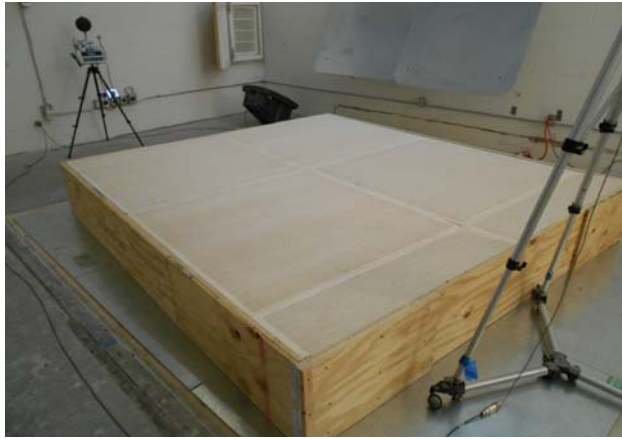

E400 test with Audition 8 (1" backing)

Frequency f [Hz]	$\alpha_s$ 1/3 octave
100	0.84
125	0.57
160	0.70
200	0.61
250	0.71
315	0.82
400	0.80
500	0.86
630	0.92
800	0.91
1000	0.93
1250	0.88
1600	0.82
2000	0.80
2500	0.81
3150	0.81
4000	0.86
5000	0.89

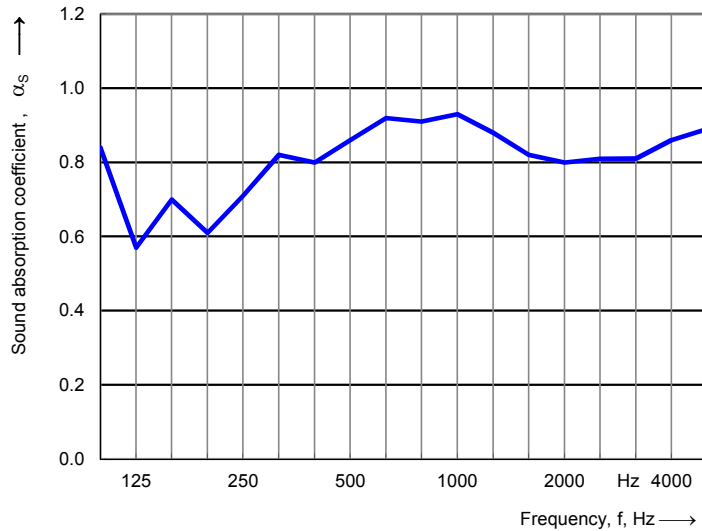

Sound Absorption Average SAA:	0.82
Noise Reduction Coefficient NRC:	0.85

Name of test institute: Orfield Labs  
 No. of test report: OL19-0726

Date: 8/2/2019

Signature:

ELECTRONICALLY  
 REPRODUCED  
 FOR INFORMATION